




Tank Breather Filter with Spin-On Filter Cartridge BL up to 1800 l/min

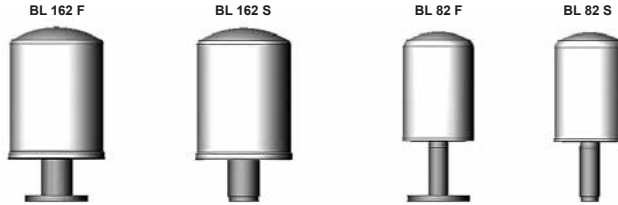

1. TECHNICAL SPECIFICATIONS

1.1 FILTER HOUSING

Construction

The filters consist of a spin-on filter can which screws onto a connection tube installed on the oil tank.

The connection can either be a flanged or weld version.

1.2 FILTER ELEMENTS

Contamination retention capacities in g

BL	10 µm	20 µm
82	67.6	99.4
162	192.0	201.3

The filter elements are made from phenolic resin impregnated paper and cannot therefore be cleaned.

1.3 FILTER SPECIFICATIONS

Temperature range	-30 °C to +100 °C
Material of connection tube	Steel
Material of spin-on can	Sheet steel
Type of clogging indicator	VMF (return line indicator)
Pressure setting of clogging indicator	0.6 bar (K pressure gauge)

1.4 SEALS

- Perbunan (=NBR)
- Cardboard on the mounting flange

1.5 SPECIAL MODELS AND ACCESSORIES

- With connection for a clogging indicator
- With filler adapter

1.6 SPARE PARTS

See Original Spare Parts List

1.7 CERTIFICATES AND APPROVALS

On request

1.8 COMPATIBILITY WITH HYDRAULIC FLUIDS ISO 2943

The standard models are suitable for use with mineral and lubrication oils. For fire-resistant and biodegradable oils, see table:

Fire-resistant fluids

BL	HFA	HFC	HFD-R
82	●	●	-
162	●	●	-

- HFA oil in water emulsion (H₂O content ≥ 80 %)
- HFC water polyglycol solution (H₂O content 35-55 %)
- HFD-R synthetic, water-free phosphate ester

Biodegradable fluids

BF	HTG	HE	HPG	PRG
			PAG	PRG
82, 162	+	+	●	●


- + suitable for all
- contact our Technical Sales Department
- not suitable

- HTG vegetable oil based hydraulic fluids
- HE ester-based synthetic hydraulic fluids
- HPG polyglycol-based synthetic hydraulic fluids
- PAG sub-group of HPG: polyalkylene glycol
- PEG sub-group of HPG: polyethylene glycol

1.9 CHANGING INTERVALS

The filter elements or filters must be replaced as frequently as the fluid filters, but at least every 12 months.

Symbol

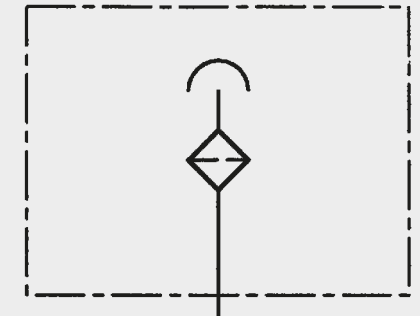

2. MODEL CODE (also order example)

BL P 162 S 10 W 1 . X /-FA12

2.1 COMPLETE FILTER

Filter type _____

BL

Filter material of element _____

P Paper

BN Betamicon® (for BL 82: only 20 µm available)

Size of filter or element _____

BL: 82, 162

Type and size of connection _____

Type	Connection	Filter size	
		82	162
F	Flange connection	●	●
S	Weld connection	●	●

Filtration rating in µm _____

P 10 absolute = 3µm in air

BN 10 = 1 µm absolute in air

20 = 2 µm absolute in air

Type of clogging indicator _____

W without port, no clogging indicator

K pressure gauge, measurement range -1 to +0.6 bar

Type code _____

1 for BL 82

2 for BL 162

Modification number _____

X the latest version is always supplied

Supplementary details _____

FA12 with filler adapter G ½

FA34 with filler adapter G ¾

FA1 with filler adapter G 1

only for BL 162

2.2 REPLACEMENT ELEMENT

0080 MG 010 P

Size _____

0080 only BL 82

0160 only BL 162

Type _____

MA only BL BN 162...

MU only BL P 162...

MG only BL .. 82...

Filtration rating in µm _____

P : 010

BN : 010, 020 (for BL 82: only 20 µm available)

Filter material _____

P, BN

2.3 REPLACEMENT CLOGGING INDICATOR

VMF 0.6 K . X

Type of indicator _____

VMF return line pressure indicator

Pressure setting _____

0.6 -1 to +0.6 bar

Type of clogging indicator _____

K (see Point 2.1)

Modification number _____

X the latest version is always supplied

3. FILTER CALCULATION / SIZING

3.1 SINGLE PASS FILTRATION PERFORMANCE DATA FOR AIR FILTER ELEMENTS

The following separation values were established under real-life simulated conditions.

This means that the selected velocity of the flow against the filter mesh-pack was 20 cm/s and the contamination added was 40 mg/m³ of ISO MTD test dust.

Filtration rating	Retention value d...	For particle size	Filter material
10 µm	d 80	0.25 µm	BN
	d 100	0.84 µm	
20 µm	d 80	0.36 µm	P
	d 100	1.21 µm	
10 µm	d 80	1.49 µm	P
	d 100	9.56 µm	

The d 80 value refers to the particle size which is filtered out at a rate of 80 % during the retention test. The particle size determined by this method is called the nominal filtration rating of the air filter. The d 100 value therefore refers to the particle size which is filtered out at a rate of 100 % during the single pass test. The particle size determined by this method is called the absolute filtration rating of the air filter.

Table of average dust concentrations in real life:

Urban regions with a low level of industry	3-7 mg/m ³ air
General mechanical engineering	9-23 mg/m ³ air
Construction industry (wheeled vehicles)	8-35 mg/m ³ air
Construction industry (tracked vehicles)	35-100 mg/m ³ air
Heavy industry	50-70 mg/m ³ air

3.2 DIFFERENTIAL PRESSURE ACROSS BREATHER FILTER

The differential pressure (with clean element) for the various filter sizes is shown in the graphs under Point 3.4.

3.3 SIZING GUIDELINES

The rate at which contamination enters a hydraulic system can be considerably reduced by using efficient tank breather filtration.

CAUTION:

Incorrectly sized tank breather filters can place additional strain on the system and reduce the service life of hydraulic filter elements.


For optimum sizing the following should therefore be observed:

- Filtration rating of breather filter = filtration rating of hydraulic filter
- Only use breather filters with an absolute retention rate (d100 = x µm; x = given filtration rating)
- Max. permitted initial pressure drop: 0.01 bar (with a clean filter element and at calculated air flow)
- Determining the calculated air flow:
 $Q_A = f5 \times Q_p$
 Q_A = calculated air flow in l_N/min
 $f5$ = factor for operating conditions
 Q_p = max. flow rate of the hydraulic pump in l/min


Ambient conditions	Factor f5
Low dust concentration; filter fitted with clogging indicator; continuous monitoring of the filter	1-2
Average dust concentration; filter without clogging indicator; intermittent monitoring of the filter	3-6
High dust concentration; filter without clogging indicator; infrequent or no monitoring of the filter	7-10

3.4 AIR FLOW RATE

BL 82

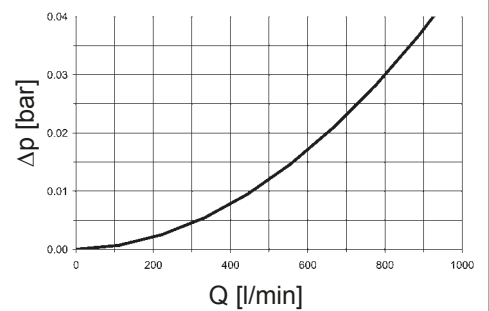

BL 162

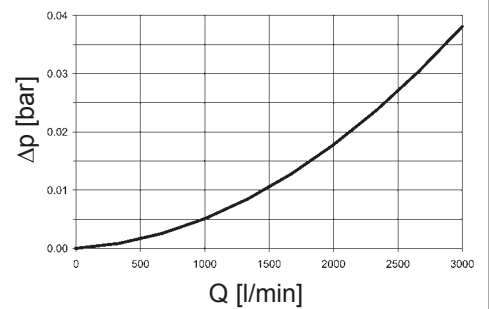


4. DIMENSIONS


Tank requirements

1. In the filter contact area, the tank flange should have a maximum flatness of 0.2 mm and RA 3.2 µm maximum roughness.
2. In addition, the contact area should be free of damage and scratches.
3. The fixing holes of the tank flange must be blind, or stud bolts with threadlocker must be used to fix the filter. As an alternative, the tank flange can be continuously welded from the inside.
4. Both the tank sheet metal and/or the filter mounting flange must be sufficiently robust so that neither deform when the seal is compressed during tightening.

BL 82 S..., BL 162 S...

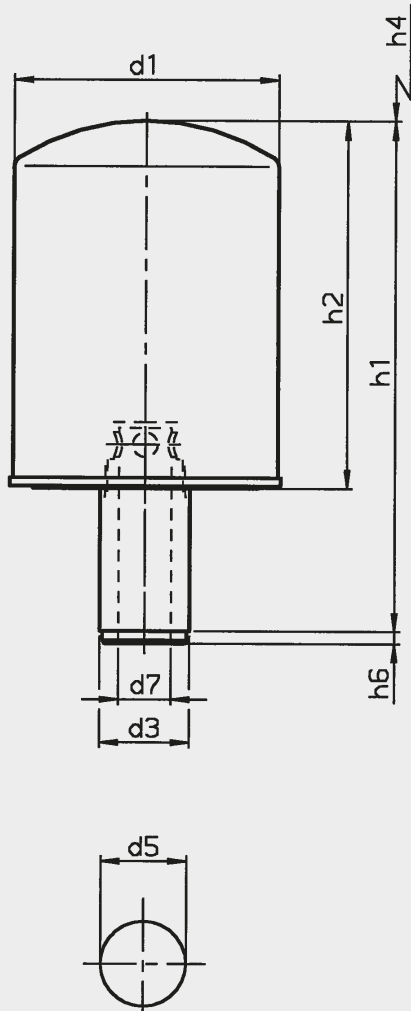

BL 82 F..., BL 162 F...

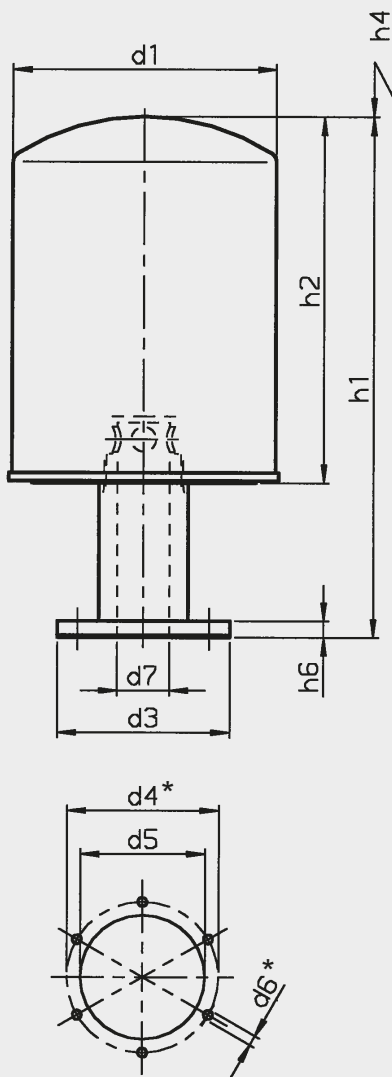

* = Flange connection DIN 24557


	BL 82 S...	BL 162 S...
d1	94	127
d3	27	43
d5	25	41
d7	16	25
h1	187	238
h2	146	176
h4	90	90
h6	7	7
Weight	0.73 kg	1.90 kg

	BL 82 F...	BL 162 F...
d1	94	127
d3	83	80
d4	*	*
d5	60	60
d6	*	*
d7	16	25
h1	194	246
h2	146	176
h4	90	90
h6	7	7
Weight	1.00 kg	2.10 kg

NOTE

The information in this brochure relates to the operating conditions and applications described.
For applications or operating conditions not described, please contact the relevant technical department.
Subject to technical modifications.

5. FILLER ADAPTER

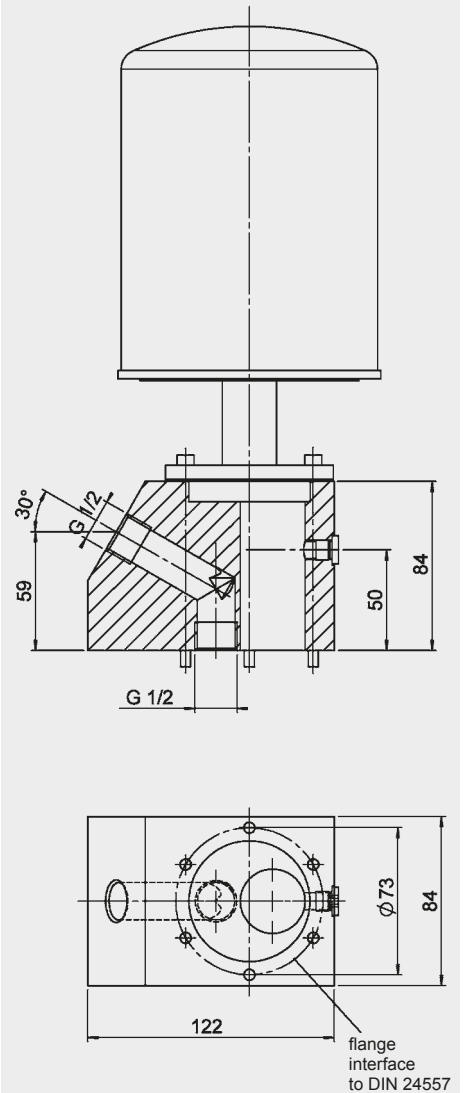

These filler adapters are available in the following threaded connections:

- Adapter FA12
Connection: G 1/2
(Part No.: 00318597)
- Adapter FA34
Connection: G 3/4
(Part No.: 01282563)
- Adapter FA1
Connection: G 1
(Part No.: 01274065)

HYDAC Filtrertechnik GmbH

Industriegebiet
D-66280 Sulzbach/Saar
Tel.: 0 68 97 / 509-01
Fax: 0 68 97 / 509-300
Internet: www.hydac.com
E-Mail: filter@hydac.com