


# Modular reducing valves type HG, KG, JPG-2 and JPG-3

spool type, ISO 4401 sizes 06, 10, 16 and 25

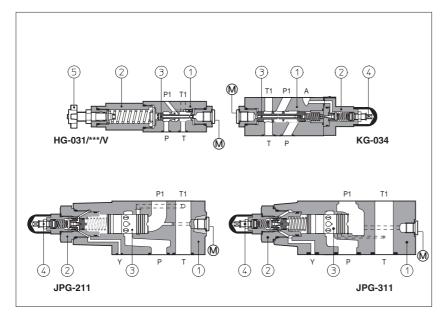

31

HG, KG, JPG are pressure reducing valves, spool type 3, designed to operate in oil hydraulic systems.

HG are direct, three way valves;

KG are double stage ① ②, three way valves; JPG are double stage (1) (2), two way valves. Clockwise rotation increases the pressure.

Valve size and max flow:

size 06 flow up to 50 I/min; KG =size 10 flow up to 100 l/min; **JPG-2** = size 16 flow up to 250 l/min; **JPG-3** = size 25 flow up to 300 l/min;

Mounting surface: ISO 4401 size 06, 10, 16 and 25

Max pressure: 350 bar for HG

315 bar for KG and JPG

#### MODEL CODE

HG-0 Modular pressure reducing valve, size: HG-0 = 06**JPG-2** = 16 **KG-0** = 10 JPG-3 = 25Configuration, see section 2

two way (only for JPG):

11 = reduced pressure on P port

three way (only for HG-0 and KG-0):

31 = reduced pressure on P port

34 = reduced pressure on B port

33 = reduced pressure on A port




Seals material, see section 3: = NBR PE = FKM BT = HNBR

V = setting adjustment by handwheel instead of a grub screw protected by cap Only for HG:

**VF** = regulating knob/**VS** = regulating knob with safety locking

Pressure range HG **100** = 7 - 100 bar **100** = 6 - 100 bar **100** = 20 - 100 bar 32 = 3 - 32 bar 50 = 2 - 50 bar **210** = 50 - 210 bar **210** = 8 - 210 bar 210 = 70 - 210 bar **75** = 10 - 75

## HYDRAULIC CHARACTERISTICS

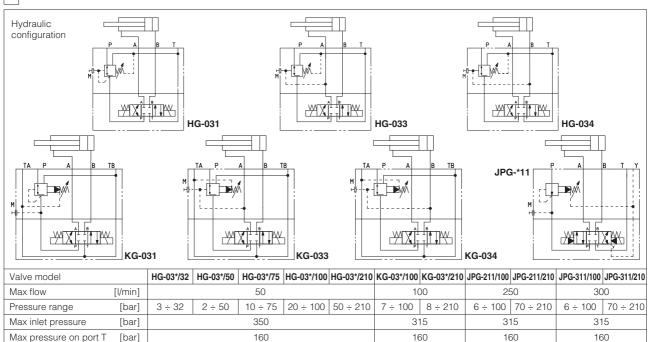



#### 3 MAIN CHARACTERISTICS, SEALS and HYDRAULIC FLUID - for other fluids not included in below table, consult our technical office

Assembly position / location	Any position		
Subplate surface finishing	Roughness index Ra 0,4 - flatness ratio 0,01/100 (ISO 1101)		
MTTFd values according to EN ISO 13849	150 years, for further details see technical table P007		
Ambient temperature	Standard execution = -30°C ÷ +70°C /PE option = -20°C ÷ +70°C /BT option = -40°C ÷ +70°C		
Seals, recommended fluid temperature	NBR seals (standard) = -20°C $\div$ +60°C, with HFC hydraulic fluids = -20°C $\div$ +50°C FKM seals (/PE option)= -20°C $\div$ +80°C HNBR seals (/BT option)= -40°C $\div$ +60°C, with HFC hydraulic fluids = -40°C $\div$ +50°C		
Recommended viscosity	15÷100 mm²/s - max allowed range 2.8 ÷ 500 mm²/s		
Fluid contamination class	ISO 4406 class 21/19/16 NAS 1638 class 10, in line filters of 25 μm (β10 ≥75 recommended)		
Hydraulic fluid	Suitable seals type	Classification	Ref. Standard
Mineral oils	NBR, FKM, HNBR	HL, HLP, HLPD, HVLP, HVLPD	DIN 51524
Flame resistant without water	FKM	HFDU, HFDR	ISO 12922
Flame resistant with water	NBR, HNBR	HFC	

#### 4 DIAGRAMS OF HG-03\* based on mineral oil ISO VG 46 at 50°C


- 1 = regulated pressure variation versus flow:
  - between use port and discharge port
  - between inlet port and use port
- 2 = differential pressure variation versus flow between inlet port and use port
- 3 = differential pressure variation versus flow between use port and discharge port






## 5 DIAGRAMS OF KG-03\* based on mineral oil ISO VG 46 at 50°C


- 1 = regulated pressure variation versus flow:
  - between use port and discharge port
  - between inlet port and use port
- 2 = differential pressure variation versus flow between inlet port and use port
- 3 = differential pressure variation versus flow between use port and discharge port






#### 6 DIAGRAMS OF JPG-211 based on mineral oil ISO VG 46 at 50°C


- 1 = regulated pressure variation versus flow between inlet port and use port
- 2 = differential pressure variation versus flow between use port and discharge port








# 7 DIAGRAMS OF JPG-311 based on mineral oil ISO VG 46 at 50°C

- 1 = regulated pressure variation versus flow between inlet port and use port
- 2 = differential pressure variation versus flow between use port and discharge port





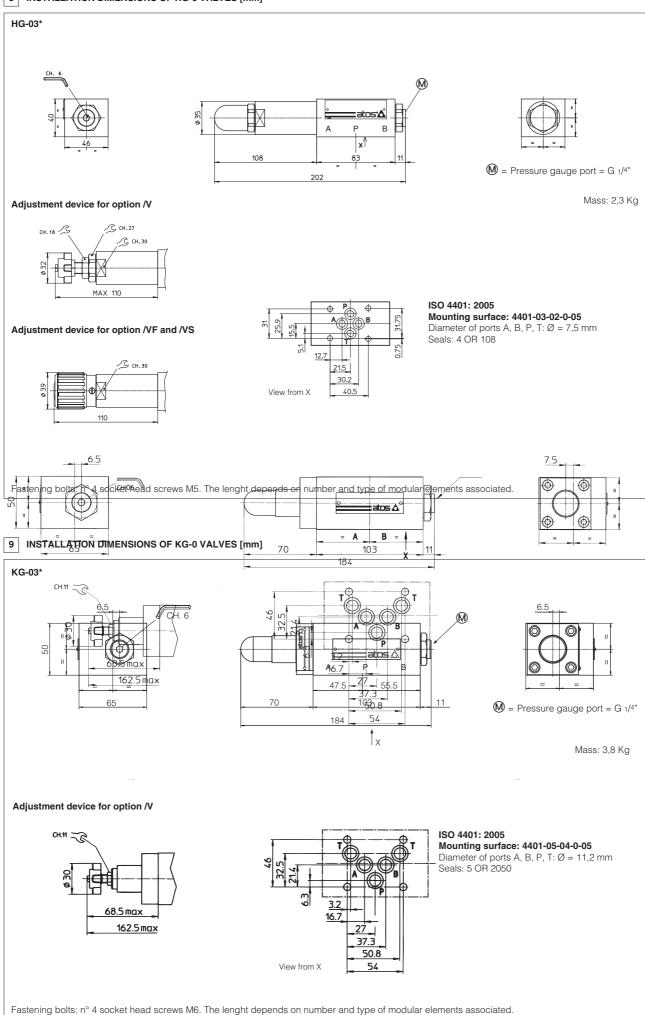

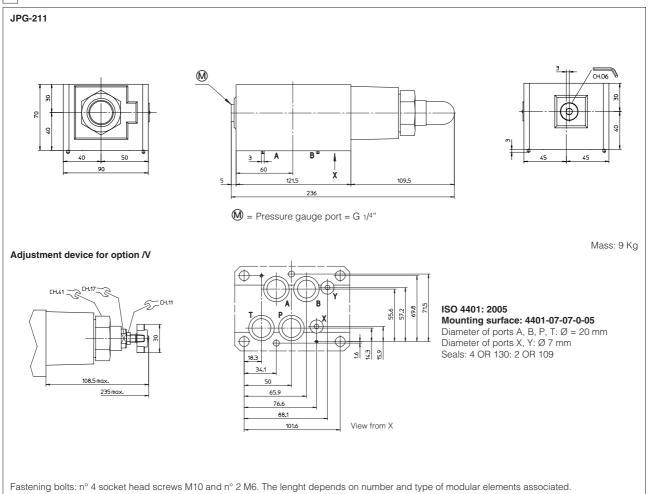

#### 11 INSTALLATION DIMENSIONS OF JPG-3 VALVES [mm]

